


<p><b>NOTES</b></p> <p>1) This drawing is for illustration purposes only and is subject to change without notice. TIC is not responsible for any errors or omissions.</p>	<p>Drawn by JE Date 08/30/05</p> <p>Approved by JIS Date 08/30/05</p>	<p><b>TOSHIBA</b></p> <p>INTERNATIONAL CORPORATION Houston Texas, USA</p> <p>THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF TOSHIBA INTERNATIONAL CORPORATION AND SHALL NOT BE REPRODUCED, USED, OR DISCLOSED TO OTHERS UNLESS PRIOR WRITTEN AUTHORIZATION IS OBTAINED.</p>	<p><b>TITLE</b></p> <p>One-Line Diagram 80 kVA <b>G8000 Series</b> UPS 480V Single Input, 480Y/277V Output, with External 3-Breaker Bypass Panel</p> <p>DRAWING NO. T80S3K08KX6NSN2-E3-SI</p> <p>REV. 2.0</p>
---	---	---	---

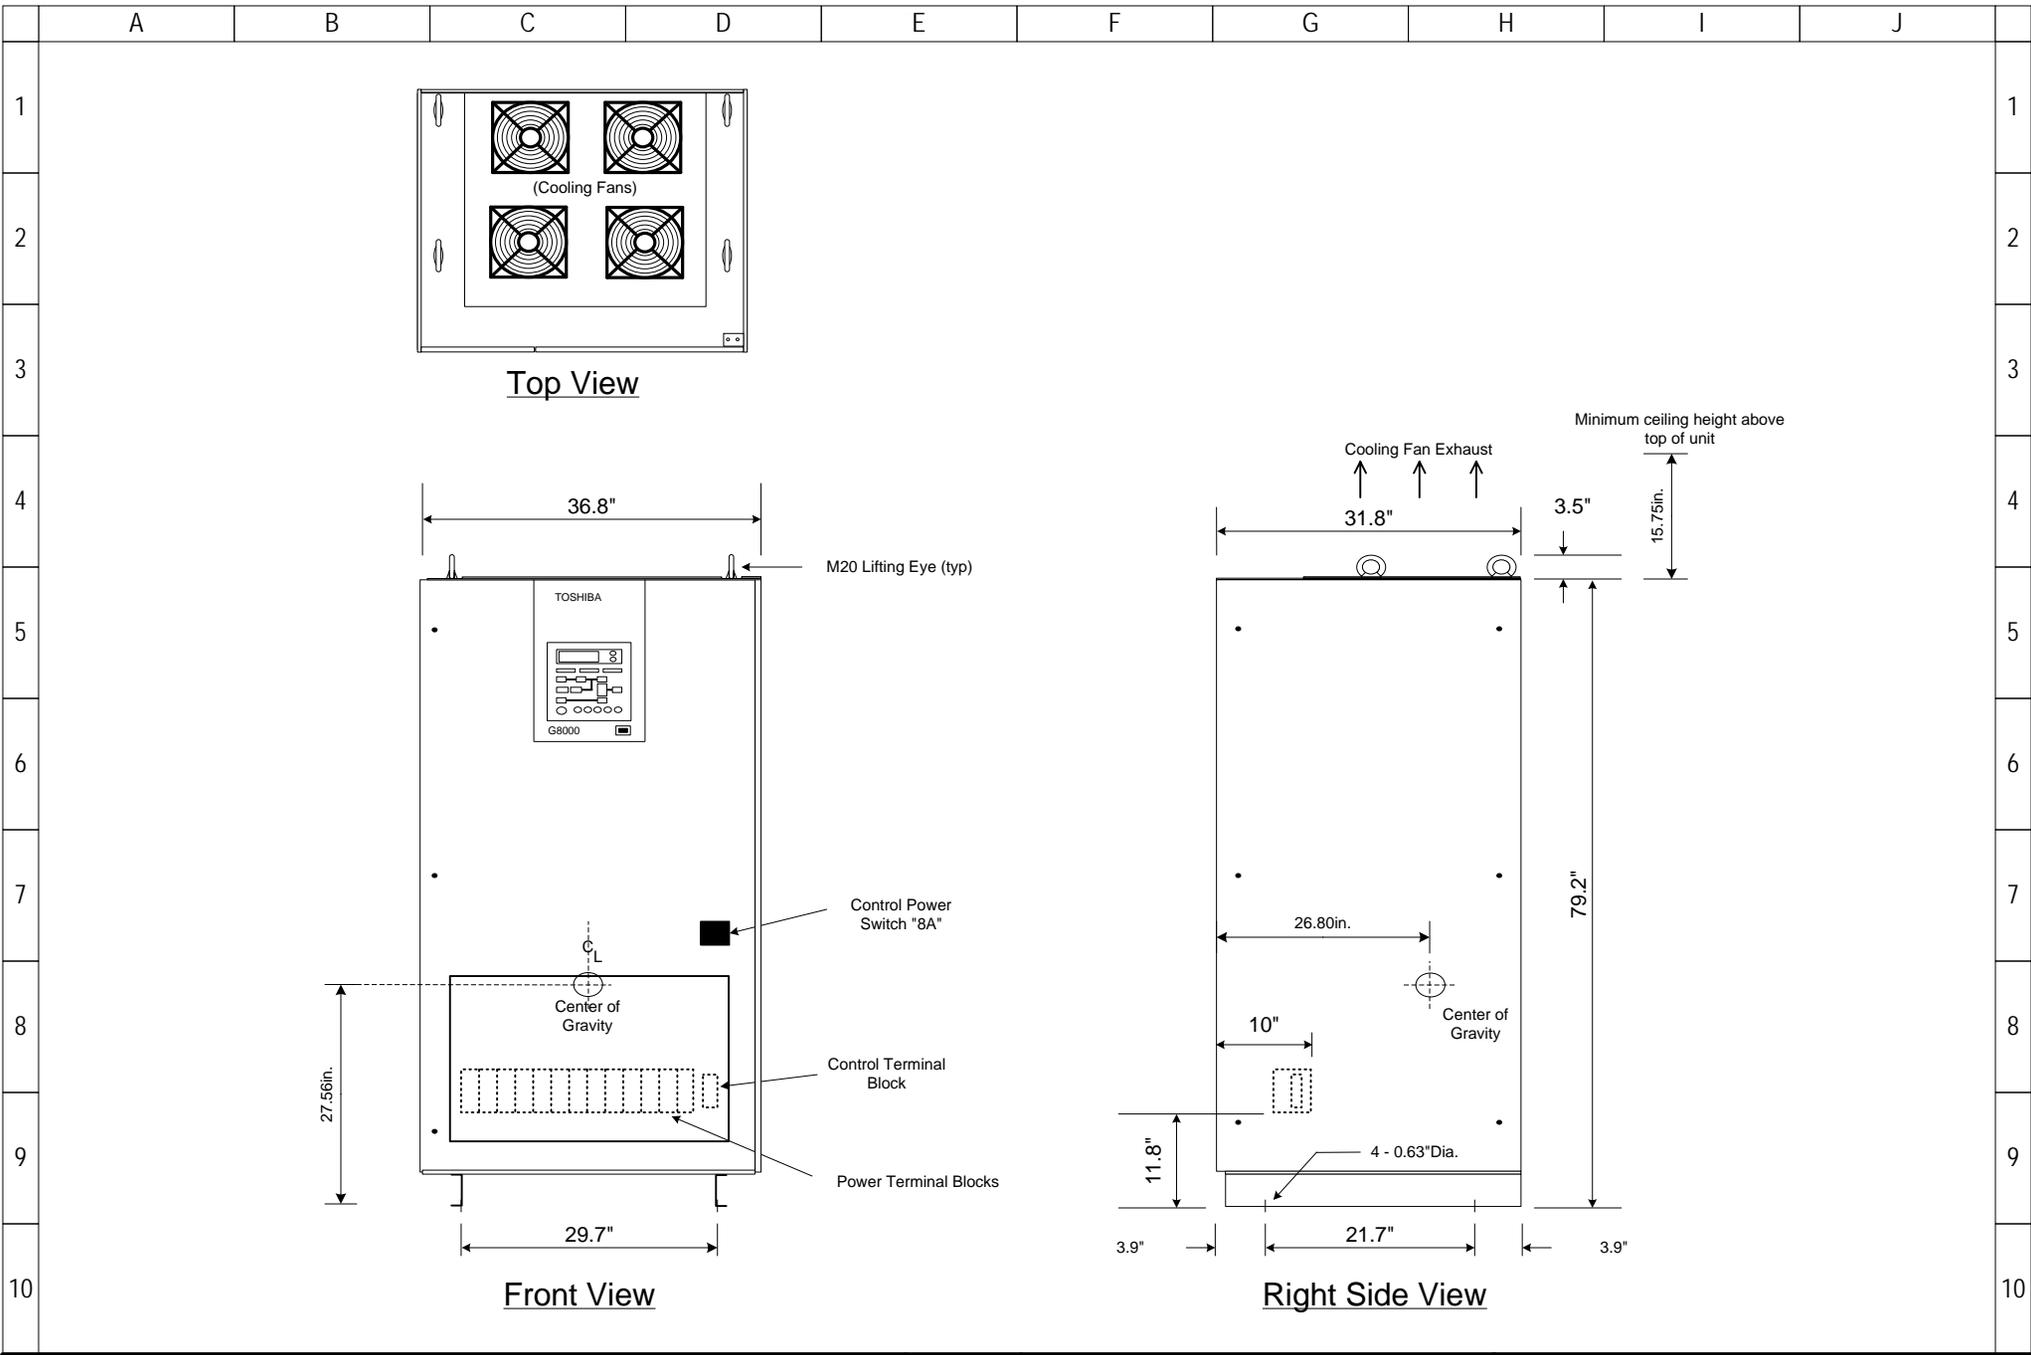

**NOTES**

- 1) This drawing is for illustration purposes only and is subject to change without notice. TIC is not responsible for any errors or omissions.
- 2) UPS enclosure type: NEMA 1 Free-standing.

Drawn by  
JE  
Date 10/06/05  
Approved by

**TOSHIBA**  
INTERNATIONAL CORPORATION  
Houston Texas, USA

THIS MATERIAL IS THE EXCLUSIVE PROPERTY OF TOSHIBA INTERNATIONAL CORPORATION AND SHALL NOT BE REPRODUCED, USED, OR DISCLOSED TO OTHERS UNLESS PRIOR WRITTEN AUTHORIZATION IS OBTAINED.

TITLE Outline Diagram 80kVA <b>G8000 Series</b> UPS, 480V Input and Output, Standard UPS Cabinet	
DRAWING NO. T80S3K08K-OUTLINE-PHASE 2	REV. 1.0